

ADDENDUM NO. 01

OWNER: Municipality of Southwest Middlesex
153 McKellar Street
Glencoe Ontario N0L 1M0

DATE: September 4, 2026

PROJECT: Glencoe Operations Centre
226 Appin Road
Glencoe ON

PROJECT NUMBER: 226069



**SPRIET
ASSOCIATES**
ENGINEERS & ARCHITECTS
155 York Street
London, Ontario N6A 1A8
Tel. (519) 672-4100
Fax (519) 433-9351
E-mail: mail@spriet.on.ca
www.spriet.on.ca

This Addendum forms part of the contract documents and is to be read, interpreted, and co-ordinated with all other parts.


The cost of all contained herein is to be included in the contract sum. The following revisions supersede the information contained in the original drawings and specifications issued for the above-named project to the extent referenced and shall become part thereof. Acknowledge receipt of this Addendum by inserting its number on the Tender Form. Failure to do so may subject the Bidder to disqualification.

Description:

ITEM	QUESTION
1	Can you assist our company in obtaining a bidders list for the Glencoe Operations Project?
Spriet Response	Bidders list is available for download on Biddingo.
2	Can you advise how we can get access to the SP1 documents?
Spriet Response	Drawing SP1 is included in this Addendum.
3	We reviewed the shop drawing requirements in the bid documents. Could you please confirm whether formal shop drawings are required for the following items in addition to the manufacturer's product data sheets and technical information?
Spriet Response	Shop drawings are required only for steel siding. Shop drawings for Gypsum Board assemblies, Acoustical Ceiling and Rough Carpentry are not required.

Attachment: Drawing SP1, dated 4/09/26


- END OF ADDENDUM NO. 01 -

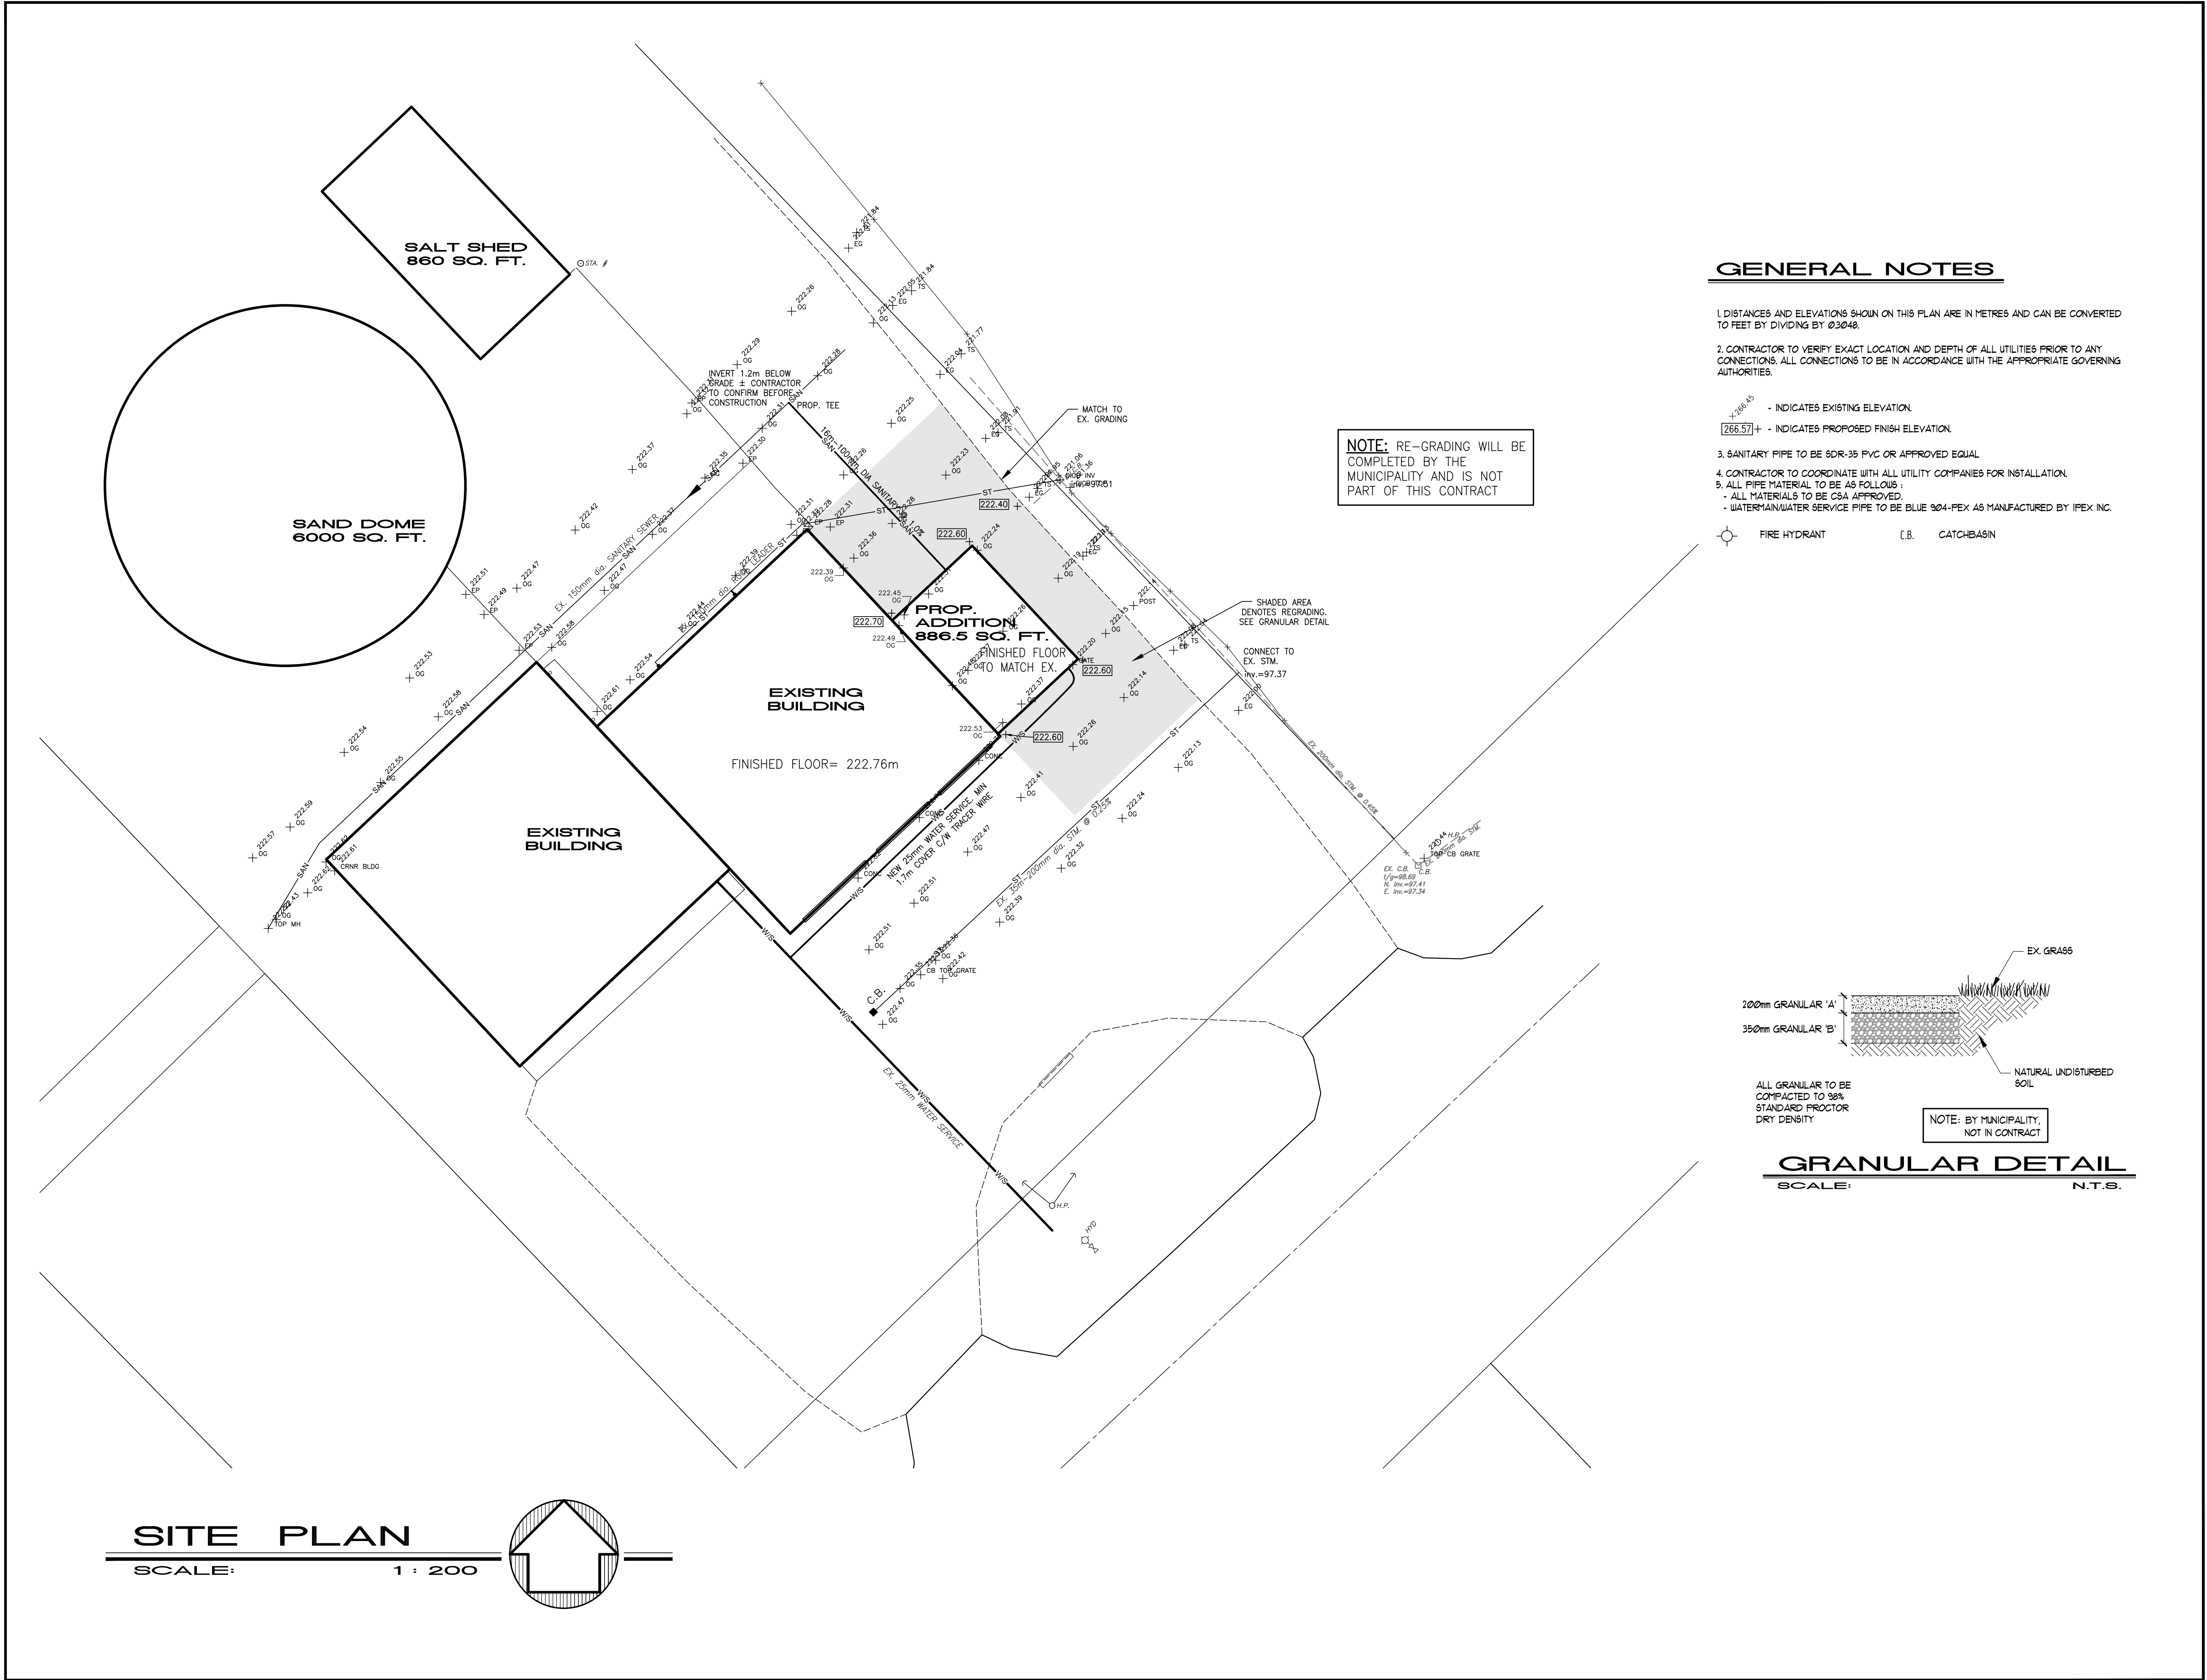

GENERAL NOTES

1. DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048.
2. CONTRACTOR TO VERIFY EXACT LOCATION AND DEPTH OF ALL UTILITIES PRIOR TO ANY CONNECTIONS. ALL CONNECTIONS TO BE IN ACCORDANCE WITH THE APPROPRIATE GOVERNING AUTHORITIES.
3. SANITARY PIPE TO BE SDR-35 PVC OR APPROVED EQUAL
4. CONTRACTOR TO COORDINATE WITH ALL UTILITY COMPANIES FOR INSTALLATION.
5. ALL PIPE MATERIAL TO BE AS FOLLOWS:
- ALL MATERIALS TO BE CSA APPROVED.
 - WATERMAIN/WATER SERVICE PIPE TO BE BLUE 904-FEX AS MANUFACTURED BY IPEX INC.

FIRE HYDRANT C.B. CATCHBASIN

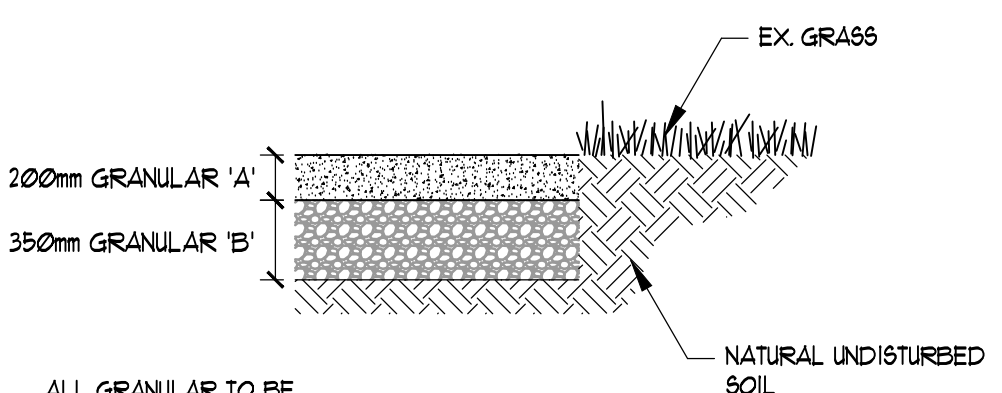

ALL GRANULAR TO BE COMPACTED TO 98% STANDARD PROCTOR DRY DENSITY

NOTE: BY MUNICIPALITY, NOT IN CONTRACT

GRANULAR DETAIL

SCALE: N.T.S.

ISSUED FOR TENDER ADDENDUM #1			4/09/26	△
revisions		date	no.	

CONTRACTORS MUST CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCY TO THIS FIRM BEFORE PROCEEDING WITH THE WORK

A - detail no.
B - location sheet
C - detail sheet

A
B
C

LICENSED PROFESSIONAL ENGINEER
J. M. C. SPRIET
PROVINCE OF ONTARIO

SPRIET ASSOCIATES



LONDON LIMITED
architects engineers
155 YORK STREET
LONDON, ON N6B 1A8
(519) 672-4100 • mail@spriet.on.ca

**Glencoe Operations Centre
BUILDING ADDITION**

266 Appin Rd, Glencoe, ON N0L 1M0
Mun. of Southwest Middlesex

drawing title :
SITE PLAN

date : JUL. 1, 2026	drawing no. : SP1
scale : AS NOTED	
drawn by : MC	
project no. : 226069	